

Temperature Probe TP1 Series

Data Sheet

This document details the technical specification of TP1 Series (NTC type) temperature probe.

Technical Details TP1:

Sensing element	NTC
No-load resistance at 25°C	10kΩ
Resistance tolerance at 25°C	± 1%
Beta(25/85) constant	3977K ± 1%
Operating temperature range	-40°C to 150°C
Probe length	40mm
Probe diameter	4mm
Probe housing material	Stainless steel SS316L
Cable type	2 x 0,16 mm² silicone / Teflon insulated
Cable length	3000 / 6000 / 12000 mm
Protection Class (Humidity Resistance)	IP68
Dielectric Strength	500VAC
Thermal Time Constant	Less than 6 sec*
RoHS Compliant	Yes


Note: Tensile loads on the cable to the probe sleeve >20N are not permitted

**Less than 6 seconds for more than 90% of the tested probes (less than 3 sec for 63%).

Part Number:

Type	Part Code	Packaging (pcs)
TP1-NP3	804489	1
TP1-NP6	804490	1
TP1-NP12	804491	1
TP1-NP3	804489M	20
TP1-NP6	804490M	20
TP1-NP12	804491M	20


Nomenclature:

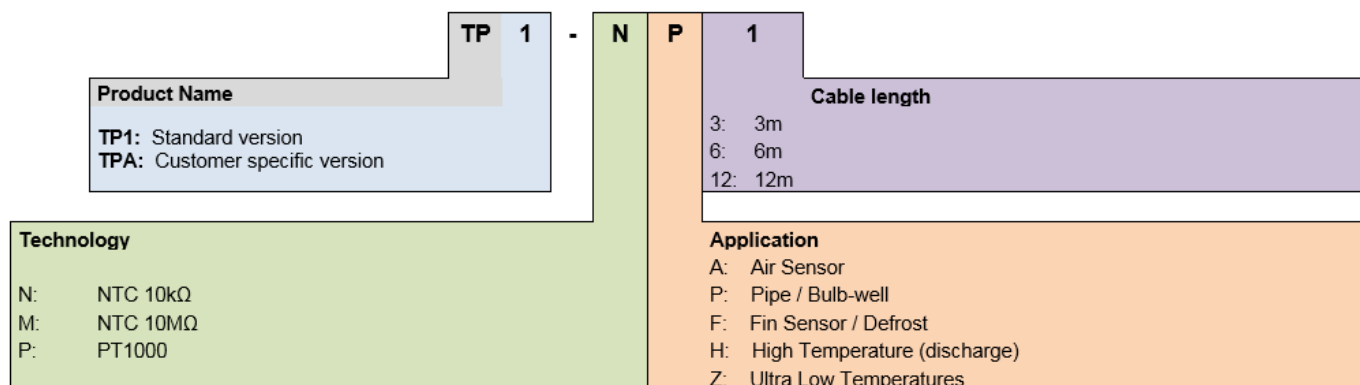

Temperature Probe TP1 Series

Data Sheet

Drawing (dimensions are in mm):

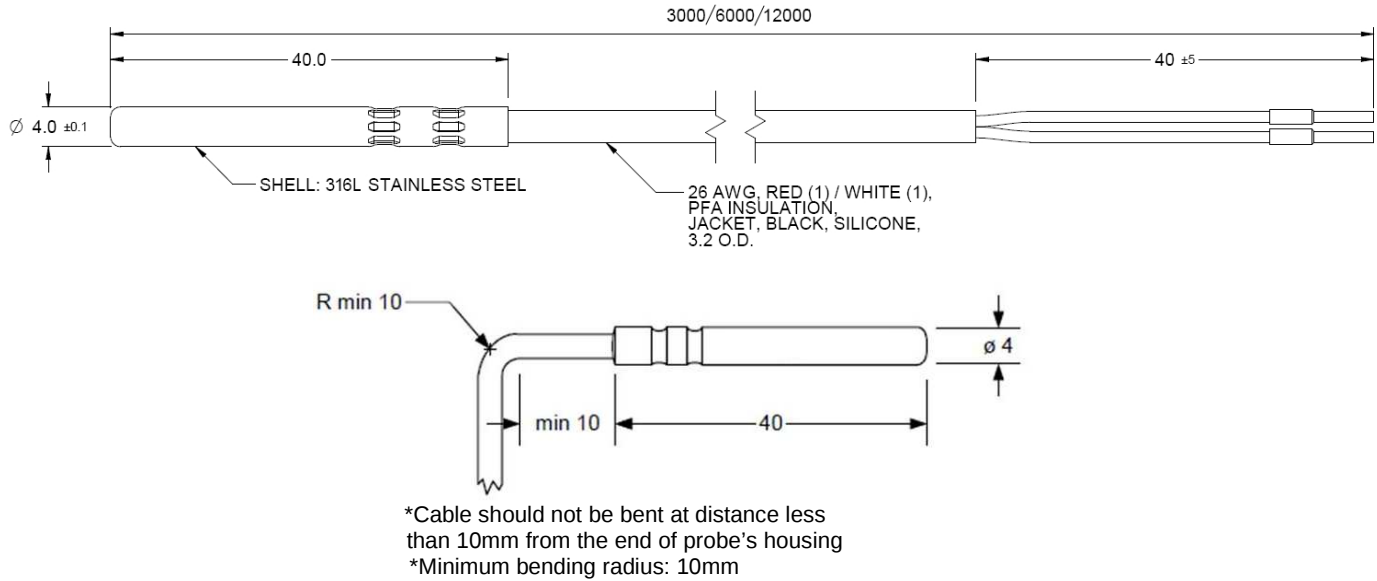

Resistance / Temperature CHARACTERISTIC:

Temp °C	Rmax kΩ	Ravg kΩ	Rmin kΩ	ΔR	-ΔR	ΔT(°C)	
-40	340.7	325.7	311.4	4.6%	-4.4%	0.7	-0.7
-39	319.2	305.4	292.2	4.5%	-4.3%	0.7	-0.7
-38	299.2	286.5	274.3	4.4%	-4.3%	0.7	-0.7
-37	280.6	268.8	257.5	4.4%	-4.2%	0.7	-0.7
-36	263.2	252.3	241.9	4.3%	-4.1%	0.7	-0.7
-35	247.0	236.9	227.2	4.2%	-4.1%	0.7	-0.7
-34	231.9	222.6	213.6	4.2%	-4.0%	0.7	-0.7
-33	217.7	209.1	200.8	4.1%	-4.0%	0.7	-0.7
-32	204.6	196.6	188.9	4.1%	-3.9%	0.7	-0.7
-31	192.3	184.9	177.8	4.0%	-3.8%	0.7	-0.6
-30	180.7	173.9	167.3	3.9%	-3.8%	0.7	-0.6
-29	170.0	163.7	157.6	3.9%	-3.7%	0.7	-0.6
-28	159.9	154.1	148.4	3.8%	-3.7%	0.7	-0.6
-27	150.5	145.1	139.9	3.7%	-3.6%	0.6	-0.6
-26	141.7	136.7	131.8	3.7%	-3.6%	0.6	-0.6
-25	133.5	128.8	124.3	3.6%	-3.5%	0.6	-0.6
-24	125.8	121.4	117.3	3.6%	-3.4%	0.6	-0.6
-23	118.5	114.5	110.7	3.5%	-3.4%	0.6	-0.6
-22	111.8	108.0	104.5	3.4%	-3.3%	0.6	-0.6
-21	105.4	102.0	98.6	3.4%	-3.3%	0.6	-0.6
-20	99.43	96.26	93.15	3.3%	-3.2%	0.6	-0.6

Note: ΔR reflects change in resistance value and ΔB reflects change in Beta value.

Temperature Probe TP1 Series

Data Sheet

Temp °C	Rmax kΩ	Ravg kΩ	Rmin kΩ	ΔR	-ΔR	ΔT(°C)	
-19	93.85	90.91	88.02	3.2%	-3.2%	0.6	-0.6
-18	88.61	85.88	83.20	3.2%	-3.1%	0.6	-0.6
-17	83.69	81.16	78.67	3.1%	-3.1%	0.6	-0.6
-16	79.07	76.72	74.42	3.1%	-3.0%	0.6	-0.6
-15	74.74	72.56	70.41	3.0%	-3.0%	0.6	-0.5
-14	70.66	68.64	66.64	2.9%	-2.9%	0.5	-0.5
-13	66.83	64.95	63.10	2.9%	-2.8%	0.5	-0.5
-12	63.22	61.48	59.76	2.8%	-2.8%	0.5	-0.5
-11	59.84	58.22	56.62	2.8%	-2.7%	0.5	-0.5
-10	56.65	55.15	53.66	2.7%	-2.7%	0.5	-0.5
-9	53.65	52.25	50.88	2.7%	-2.6%	0.5	-0.5
-8	50.82	49.53	48.25	2.6%	-2.6%	0.5	-0.5
-7	48.16	46.96	45.77	2.6%	-2.5%	0.5	-0.5
-6	45.65	44.54	43.43	2.5%	-2.5%	0.5	-0.5
-5	43.29	42.25	41.23	2.5%	-2.4%	0.5	-0.5
-4	41.06	40.10	39.15	2.4%	-2.4%	0.5	-0.5
-3	38.96	38.07	37.19	2.3%	-2.3%	0.5	-0.5
-2	36.98	36.15	35.33	2.3%	-2.3%	0.5	-0.5
-1	35.11	34.34	33.58	2.2%	-2.2%	0.5	-0.4
0	33.35	32.63	31.92	2.2%	-2.2%	0.4	-0.4
1	31.68	31.02	30.36	2.1%	-2.1%	0.4	-0.4
2	30.11	29.49	28.88	2.1%	-2.1%	0.4	-0.4
3	28.62	28.05	27.48	2.0%	-2.0%	0.4	-0.4
4	27.22	26.68	26.16	2.0%	-2.0%	0.4	-0.4
5	25.89	25.39	24.91	1.9%	-1.9%	0.4	-0.4
6	24.63	24.17	23.72	1.9%	-1.9%	0.4	-0.4
7	23.44	23.02	22.60	1.8%	-1.8%	0.4	-0.4
8	22.32	21.92	21.54	1.8%	-1.8%	0.4	-0.4
9	21.25	20.89	20.53	1.7%	-1.7%	0.4	-0.4
10	20.24	19.91	19.57	1.7%	-1.7%	0.4	-0.4
11	19.29	18.98	18.67	1.6%	-1.6%	0.4	-0.4
12	18.39	18.10	17.81	1.6%	-1.6%	0.3	-0.3
13	17.53	17.26	17.00	1.6%	-1.5%	0.3	-0.3
14	16.72	16.47	16.22	1.5%	-1.5%	0.3	-0.3
15	15.95	15.72	15.49	1.5%	-1.4%	0.3	-0.3
16	15.22	15.00	14.80	1.4%	-1.4%	0.3	-0.3
17	14.52	14.33	14.13	1.4%	-1.4%	0.3	-0.3
18	13.87	13.69	13.51	1.3%	-1.3%	0.3	-0.3
19	13.24	13.08	12.91	1.3%	-1.3%	0.3	-0.3

Note: ΔR reflects change in resistance value and ΔB reflects change in Beta value.

Temperature Probe TP1 Series

Data Sheet

Temp °C	Rmax kΩ	Ravg kΩ	Rmin kΩ	ΔR	-ΔR	ΔT(°C)	
20	12.65	12.50	12.34	1.2%	-1.2%	0.3	-0.3
21	12.09	11.94	11.80	1.2%	-1.2%	0.3	-0.3
22	11.55	11.42	11.29	1.1%	-1.1%	0.3	-0.3
23	11.04	10.92	10.81	1.1%	-1.1%	0.3	-0.2
24	10.56	10.45	10.34	1.0%	-1.0%	0.2	-0.2
25	10.10	10.00	9.90	1.0%	-1.0%	0.2	-0.2
26	9.672	9.572	9.472	1.1%	-1.0%	0.2	-0.2
27	9.264	9.164	9.064	1.1%	-1.1%	0.3	-0.3
28	8.876	8.776	8.677	1.1%	-1.1%	0.3	-0.3
29	8.505	8.406	8.308	1.2%	-1.2%	0.3	-0.3
30	8.153	8.054	7.956	1.2%	-1.2%	0.3	-0.3
31	7.816	7.719	7.622	1.3%	-1.3%	0.3	-0.3
32	7.496	7.399	7.303	1.3%	-1.3%	0.3	-0.3
33	7.190	7.095	7.000	1.4%	-1.3%	0.3	-0.3
34	6.899	6.804	6.710	1.4%	-1.4%	0.3	-0.3
35	6.621	6.527	6.434	1.4%	-1.4%	0.4	-0.4
36	6.355	6.263	6.171	1.5%	-1.5%	0.4	-0.4
37	6.102	6.011	5.920	1.5%	-1.5%	0.4	-0.4
38	5.860	5.770	5.681	1.6%	-1.5%	0.4	-0.4
39	5.629	5.541	5.453	1.6%	-1.6%	0.4	-0.4
40	5.408	5.321	5.235	1.6%	-1.6%	0.4	-0.4
41	5.198	5.112	5.027	1.7%	-1.7%	0.4	-0.4
42	4.996	4.912	4.828	1.7%	-1.7%	0.4	-0.4
43	4.804	4.720	4.638	1.8%	-1.7%	0.5	-0.5
44	4.619	4.538	4.457	1.8%	-1.8%	0.5	-0.5
45	4.443	4.363	4.284	1.8%	-1.8%	0.5	-0.5
46	4.275	4.196	4.118	1.9%	-1.9%	0.5	-0.5
47	4.114	4.036	3.960	1.9%	-1.9%	0.5	-0.5
48	3.960	3.884	3.808	2.0%	-1.9%	0.5	-0.5
49	3.812	3.737	3.663	2.0%	-2.0%	0.5	-0.5
50	3.671	3.597	3.525	2.0%	-2.0%	0.5	-0.5
51	3.535	3.463	3.392	2.1%	-2.1%	0.6	-0.6
52	3.406	3.335	3.265	2.1%	-2.1%	0.6	-0.6
53	3.281	3.212	3.144	2.1%	-2.1%	0.6	-0.6
54	3.162	3.095	3.028	2.2%	-2.2%	0.6	-0.6
55	3.048	2.982	2.916	2.2%	-2.2%	0.6	-0.6
56	2.939	2.874	2.810	2.3%	-2.2%	0.6	-0.6
57	2.834	2.770	2.707	2.3%	-2.3%	0.6	-0.6
58	2.733	2.671	2.609	2.3%	-2.3%	0.7	-0.6
59	2.637	2.576	2.515	2.4%	-2.3%	0.7	-0.7

Note: ΔR reflects change in resistance value and ΔB reflects change in Beta value.

Temperature Probe TP1 Series

Data Sheet

Temp °C	Rmax kΩ	Ravg kΩ	Rmin kΩ	ΔR	-ΔR	ΔT(°C)	
60	2.544	2.484	2.425	2.4%	-2.4%	0.7	-0.7
61	2.455	2.397	2.339	2.4%	-2.4%	0.7	-0.7
62	2.370	2.313	2.256	2.5%	-2.5%	0.7	-0.7
63	2.288	2.232	2.177	2.5%	-2.5%	0.7	-0.7
64	2.210	2.155	2.100	2.6%	-2.5%	0.7	-0.7
65	2.134	2.080	2.027	2.6%	-2.6%	0.8	-0.7
66	2.062	2.009	1.957	2.6%	-2.6%	0.8	-0.8
67	1.992	1.940	1.889	2.7%	-2.6%	0.8	-0.8
68	1.925	1.874	1.825	2.7%	-2.7%	0.8	-0.8
69	1.861	1.811	1.762	2.7%	-2.7%	0.8	-0.8
70	1.7986	1.7502	1.7025	2.8%	-2.7%	0.8	-0.8
71	1.7391	1.6917	1.6451	2.8%	-2.8%	0.8	-0.8
72	1.6818	1.6355	1.5898	2.8%	-2.8%	0.9	-0.8
73	1.6267	1.5814	1.5367	2.9%	-2.8%	0.9	-0.9
74	1.5738	1.5294	1.4857	2.9%	-2.9%	0.9	-0.9
75	1.5228	1.4793	1.4366	2.9%	-2.9%	0.9	-0.9
76	1.4737	1.4312	1.3894	3.0%	-2.9%	0.9	-0.9
77	1.4264	1.3848	1.3439	3.0%	-3.0%	0.9	-0.9
78	1.3809	1.3402	1.3002	3.0%	-3.0%	0.9	-0.9
79	1.3371	1.2973	1.2581	3.1%	-3.0%	1.0	-0.9
80	1.2949	1.2560	1.2176	3.1%	-3.1%	1.0	-1.0
81	1.2543	1.2161	1.1787	3.1%	-3.1%	1.0	-1.0
82	1.2151	1.1778	1.1411	3.2%	-3.1%	1.0	-1.0
83	1.1773	1.1408	1.1049	3.2%	-3.1%	1.0	-1.0
84	1.1409	1.1052	1.0701	3.2%	-3.2%	1.0	-1.0
85	1.1059	1.0709	1.0366	3.3%	-3.2%	1.1	-1.0
86	1.0720	1.0378	1.0042	3.3%	-3.2%	1.1	-1.1
87	1.0394	1.0059	0.9730	3.3%	-3.3%	1.1	-1.1
88	1.0079	0.9751	0.9430	3.4%	-3.3%	1.1	-1.1
89	0.9776	0.9455	0.9140	3.4%	-3.3%	1.1	-1.1
90	0.9483	0.9169	0.8861	3.4%	-3.4%	1.1	-1.1
91	0.9200	0.8893	0.8591	3.5%	-3.4%	1.2	-1.1
92	0.8927	0.8626	0.8332	3.5%	-3.4%	1.2	-1.1
93	0.8664	0.8369	0.8081	3.5%	-3.4%	1.2	-1.2
94	0.8409	0.8121	0.7839	3.5%	-3.5%	1.2	-1.2
95	0.8164	0.7882	0.7605	3.6%	-3.5%	1.2	-1.2
96	0.7926	0.7650	0.7380	3.6%	-3.5%	1.2	-1.2
97	0.7697	0.7427	0.7162	3.6%	-3.6%	1.3	-1.2

Note: ΔR reflects change in resistance value and ΔB reflects change in Beta value.

Temperature Probe TP1 Series

Data Sheet

Temp °C	Rmax kΩ	Ravg kΩ	Rmin kΩ	ΔR	-ΔR	ΔT(°C)	
98	0.7476	0.7211	0.6952	3.7%	-3.6%	1.3	-1.2
99	0.7262	0.7003	0.6749	3.7%	-3.6%	1.3	-1.3
100	0.7055	0.6801	0.6553	3.7%	-3.6%	1.3	-1.3
101	0.6855	0.6607	0.6364	3.8%	-3.7%	1.3	-1.3
102	0.6662	0.6419	0.6181	3.8%	-3.7%	1.3	-1.3
103	0.6475	0.6237	0.6004	3.8%	-3.7%	1.4	-1.3
104	0.6294	0.6061	0.5833	3.9%	-3.8%	1.4	-1.3
105	0.6119	0.5891	0.5668	3.9%	-3.8%	1.4	-1.4
106	0.5950	0.5726	0.5508	3.9%	-3.8%	1.4	-1.4
107	0.5787	0.5567	0.5353	3.9%	-3.8%	1.4	-1.4
108	0.5628	0.5414	0.5204	4.0%	-3.9%	1.4	-1.4
109	0.5475	0.5265	0.5060	4.0%	-3.9%	1.5	-1.4
110	0.5327	0.5121	0.4920	4.0%	-3.9%	1.5	-1.4
111	0.5183	0.4981	0.4785	4.1%	-4.0%	1.5	-1.5
112	0.5044	0.4846	0.4654	4.1%	-4.0%	1.5	-1.5
113	0.4909	0.4716	0.4527	4.1%	-4.0%	1.5	-1.5
114	0.4779	0.4589	0.4404	4.1%	-4.0%	1.5	-1.5
115	0.4653	0.4467	0.4286	4.2%	-4.1%	1.6	-1.5
116	0.4530	0.4348	0.4171	4.2%	-4.1%	1.6	-1.5
117	0.4412	0.4233	0.4059	4.2%	-4.1%	1.6	-1.6
118	0.4297	0.4122	0.3951	4.2%	-4.1%	1.6	-1.6
119	0.4186	0.4014	0.3847	4.3%	-4.2%	1.6	-1.6
120	0.4078	0.3909	0.3746	4.3%	-4.2%	1.7	-1.6
121	0.3973	0.3808	0.3648	4.3%	-4.2%	1.7	-1.6
122	0.3871	0.3710	0.3553	4.4%	-4.2%	1.7	-1.7
123	0.3773	0.3615	0.3460	4.4%	-4.3%	1.7	-1.7
124	0.3678	0.3522	0.3371	4.4%	-4.3%	1.7	-1.7
125	0.3585	0.3433	0.3285	4.4%	-4.3%	1.8	-1.7
126	0.3495	0.3346	0.3201	4.5%	-4.3%	1.8	-1.7
127	0.3408	0.3262	0.3119	4.5%	-4.4%	1.8	-1.7
128	0.3323	0.3180	0.3040	4.5%	-4.4%	1.8	-1.8
129	0.3241	0.3100	0.2964	4.5%	-4.4%	1.8	-1.8
130	0.3162	0.3023	0.2889	4.6%	-4.4%	1.8	-1.8
131	0.3084	0.2949	0.2817	4.6%	-4.5%	1.9	-1.8
132	0.3009	0.2876	0.2747	4.6%	-4.5%	1.9	-1.8
133	0.2936	0.2806	0.2679	4.6%	-4.5%	1.9	-1.9
134	0.2865	0.2738	0.2614	4.7%	-4.5%	1.9	-1.9
135	0.2797	0.2671	0.2550	4.7%	-4.6%	1.9	-1.9
136	0.2730	0.2607	0.2487	4.7%	-4.6%	2.0	-1.9
137	0.2665	0.2544	0.2427	4.7%	-4.6%	2.0	-1.9

Note: ΔR reflects change in resistance value and ΔB reflects change in Beta value.

Temperature Probe TP1 Series

Data Sheet

Temp °C	Rmax kΩ	Ravg kΩ	Rmin kΩ	ΔR	-ΔR	ΔT(°C)	
138	0.2602	0.2483	0.2368	4.8%	-4.6%	2.0	-1.9
139	0.2541	0.2424	0.2312	4.8%	-4.6%	2.0	-2.0
140	0.2481	0.2367	0.2256	4.8%	-4.7%	2.0	-2.0
141	0.2423	0.2311	0.2203	4.8%	-4.7%	2.1	-2.0
142	0.2367	0.2257	0.2150	4.9%	-4.7%	2.1	-2.0
143	0.2312	0.2204	0.2100	4.9%	-4.7%	2.1	-2.0
144	0.2259	0.2153	0.2050	4.9%	-4.8%	2.1	-2.1
145	0.2207	0.2103	0.2002	4.9%	-4.8%	2.1	-2.1
146	0.2157	0.2055	0.1956	5.0%	-4.8%	2.2	-2.1
147	0.2108	0.2008	0.1911	5.0%	-4.8%	2.2	-2.1
148	0.2060	0.1962	0.1867	5.0%	-4.9%	2.2	-2.1
149	0.2014	0.1917	0.1824	5.0%	-4.9%	2.2	-2.2
150	0.1969	0.1874	0.1782	5.1%	-4.9%	2.3	-2.2

Note: ΔR reflects change in resistance value and ΔB reflects change in Beta value.

TP1_EN_R01

Emerson Climate Technologies GmbH shall not be liable for errors in the stated capacities, dimensions, etc., as well as typographic errors. Products, specifications, designs and technical data contained in this document are subject to modification by us without prior notice. Illustrations are not binding.
The Emerson Climate Technologies logo is a trademark and service mark of Emerson Electric Co. Emerson Climate Technologies Inc. is a subsidiary of Emerson Electric Co.

EMERSON. CONSIDER IT SOLVED.